


Testing Results for Lead in Drinking Water for Norfolk Naval Shipyard – Gosport Child Development Center - Buildings 1641-1642

The Navy is committed to maintaining safe drinking water on its installations. City water supplied to the Navy and the Navy's water distribution system is regularly tested and in compliance with the Safe Drinking Water Act. Because lead exposure is a particular concern for children, and lead may be introduced to drinking water through the pipes, fittings, solder, and fixtures inside a building, the EPA recommends, but does not mandate, that we test the lead content of drinking water in priority areas such as youth centers (YC), child development centers (CDC), and child development group homes (CDGH).

Navy environmental personnel conducted lead testing at the Norfolk Naval Shipyard – Gosport Child Development Center (CDC) – Buildings 1641 and 1642 in accordance with Navy and EPA guidelines. Samples from various locations in the CDC were sent to a state-certified laboratory for analysis.

At the Norfolk Naval Shipyard – Gosport CDC – Buildings 1641 and 1642, outlets used for drinking and cooking, as well as outlets used for hand washing were tested. All 87 of the outlets tested were within EPA's recommended lead level of 20 ppb. One part per billion is equal to one drop of water in an Olympic-size swimming pool.

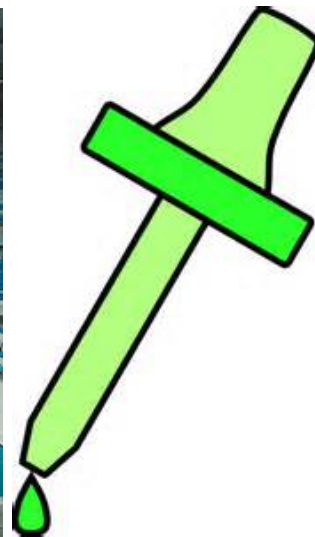

A copy of all test results is enclosed for your information. The test results are presented in two tables:

- Table 1 **Summary of Results** summarizes the data by category of use (e.g., drinking, cooking, washing).
- Table 2 **Summary Statistics** summarizes all the data.

Table 1 provides a description of each sampling location using three columns; *Category*, *Outlet No.*, and *Outlet Description*. The *Category* column gives information about whether the outlet is used for drinking water (water fountain), cooking (food preparation), or washing (primarily hand-washing). The *Outlet No.* column is the number used to identify each outlet location and

corresponds to the outlet number on the floor plan. The *Outlet Description* column contains additional information to describe the outlet sampled under each category.

The next set of columns in **Table 1** provide *Initial Sampling Results*, and for those locations that exceeded the recommended level of 20 ppb, the *Re-sampling Results*.

EPA sampling protocol requires water to not be used for between 8 and 18 hours prior to first draw sampling. Therefore, the *Initial Sampling Results* include a sub-column for *First Draw* samples collected early in the morning before the CDC opened and before any water was used. Additional sub-columns indicate whether *Retesting* is required and the *Date Secured* for fixtures greater than 20 ppb.

The *Re-sampling Results* columns are annotated N/A since all samples at the Norfolk Naval Shipyard – Gosport CDC – Buildings 1641 and 1642 were within EPA recommended levels.

The *Corrective Actions* column describes actions that have been taken to remediate the source of lead. In the event that future fixtures or upstream piping is replaced, there are columns for *Post Remediation Sampling* data that will be documented to confirm that these corrective actions were successful in reducing lead below 20 ppb.

To learn more about lead in drinking water schools and day care centers visit this EPA website at: http://water.epa.gov/drink/info/lead/schools_index.cfm.

To learn more about your home's public water supplier, see their annual water quality report: Portsmouth: <http://www.portsmouthva.gov/publicutil/waterqualityreport.aspx>

Navy Water Quality Reports:

http://www.cnmc.navy.mil/regions/cnrma/om/environmental_support/water_quality_information.html

To answer any questions you may have on the sampling program contact the Norfolk Naval Shipyard Public Affairs Officer at **757 396-8122**. If you have any health questions or concerns, we encourage you to call your health care provider or, if you are a TRICARE beneficiary, contact the Regional Nurse Advice Line (1-800-TRICARE, press option 1) or use the Regional Appointment Center at 1-866-645-4584 to schedule an appointment with your primary care provider.

Priority Areas Lead Testing and Corrective Actions (October 2014)
Norfolk Naval Shipyard Gosport Child Development Center
Buildings 1641 and 1642

Table 1. Summary of Results

SAMPLING LOCATION DESCRIPTION			INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING	
CATEGORY Water Intended For:	Outlet No.	Outlet Description	First Draw (ppb)	Retest required?	Recommended Level = 20ppb Date Fixture Secured? (See Note 1)	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)		First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE			10/3/2014								
RESULTS DATE			10/13/2014								
DRINKING	9	Room 2-116 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	14	Room 2-118 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	19	Room 2-123 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	25	Room 2-124 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	31	Room 2-127 water fountain (bubbler)	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	37	Room 2-128 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	43	Hallway water fountain (cooler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	44	Hallway water fountain (cooler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	54	Room 1-114 icemaker	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	56	Room 1-116 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	61	Room 1-118 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	66	Room 1-123 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	72	Room 1-124 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	78	Room 1-127 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	84	Room 1-128 water fountain (bubbler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	90	Hallway water fountain (cooler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	91	Hallway water fountain (cooler)	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	4	Room 2-114 kitchen sink for dishwashing, food prep	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	5	Room 2-114 kitchen sink for dishwashing, food prep	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	7	Room 2-114 kitchen sink for dishwashing, food prep	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	42	Room 2-131 kitchen sink for dishwashing, food prep	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	50	Room 1-114 kitchen sink for dishwashing, food prep	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	51	Room 1-114 kitchen sink for dishwashing, food prep	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	53	Room 1-114 kitchen sink for dishwashing, food prep	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	89	Room 1-131 kitchen sink for dishwashing, food prep	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	17	Room 2-118 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	22	Room 2-123 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	26	Room 2-124 teeth brushing and hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	27	Room 2-124 teeth brushing and hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	57	Room 1-116 teeth brushing and hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	58	Room 1-116 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	64	Room 1-118 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	69	Room 1-123 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	73	Room 1-124 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	74	Room 1-124 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	79	Room 1-127 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	80	Room 1-127 teeth brushing and hand washing sink	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	85	Room 1-128 teeth brushing and hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING/TEETHBRUSHING	86	Room 1-128 teeth brushing and hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Priority Areas Lead Testing and Corrective Actions (October 2014)
Norfolk Naval Shipyard Gosport Child Development Center
Buildings 1641 and 1642


SAMPLING LOCATION DESCRIPTION			INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING	
CATEGORY Water Intended For:	Outlet No.	Outlet Description	First Draw (ppb)	Retest required?	Recommended Level = 20ppb	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	Recommended Level = 20ppb	
					Date Fixture Secured? (See Note 1)					First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE			10/3/2014								
RESULTS DATE			10/13/2014								
WASHING	6	Room 2-114 hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	8	Room 2-116 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	10	Room 2-116 hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	11	Room 2-116 hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	12	Room 2-116 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	13	Room 2-116 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	15	Room 2-118 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	16	Room 2-118 hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	18	Room 2-118 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	20	Room 2-123 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	21	Room 2-123 hand washing sink	3	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	23	Room 2-123 hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	24	Room 2-123 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	28	Room 2-124 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	29	Room 2-124 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	30	Room 2-127 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	32	Room 2-127 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	33	Room 2-127 hand washing sink	5	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	34	Room 2-127 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	35	Room 2-127 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	36	Room 2-128 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	38	Room 2-128 hand washing sink	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	39	Room 2-128 hand washing sink	3	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	40	Room 2-128 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	41	Restroom 2-130 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	45	Restroom 2-110 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	46	Restroom 2-106 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	52	Room 1-114 hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	55	Room 1-116 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	59	Room 1-116 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	60	Room 1-116 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Priority Areas Lead Testing and Corrective Actions (October 2014)
Norfolk Naval Shipyard Gosport Child Development Center
Buildings 1641 and 1642

SAMPLING LOCATION DESCRIPTION			INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING	
			First Draw (ppb)	Retest required?	Recommended Date Fixture Secured? (See Note 1)	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)		Recommended Level = 20ppb	
CATEGORY Water Intended For:	Outlet No.	Outlet Description							Description	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE			10/3/2014								
RESULTS DATE			10/13/2014								
WASHING	62	Room 1-118 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	63	Room 1-118 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	65	Room 1-118 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	67	Room 1-123 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	68	Room 1-123 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	70	Room 1-123 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	71	Room 1-124 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	75	Room 1-124 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	76	Room 1-124 hand washing sink	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	77	Room 1-127 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	81	Room 1-127 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	82	Room 1-127 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	83	Room 1-128 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	87	Room 1-128 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	88	Restroom 1-130 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	92	Restroom 1-110 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	93	Restroom 1-106 hand washing sink	non-detect	NO	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Table 2. Summary Statistics


CATEGORY	INITIAL SAMPLING RESULTS		RE-SAMPLING RESULTS			POST REMEDIATION
	Recommended Level = 20ppb					
	First Draw	Water Fountain Follow up Flush Sample - Collected day before First Draw Sampling	First Draw	Follow up Flush - Collected 30 seconds after First Draw Sampling	First Draw	
Total Drinking	17	0	0	0	0	
Total Drinking > 20 ppb	0	0	0	0	0	
Total Cook/Brush	8	0	0	0	0	
Total Cook/Brush > 20 ppb	0	0	0	0	0	
Total Washing	62	0	0	0	0	
Total Washing > 20 ppb	0	0	0	0	0	
Total Samples	87	0	0	0	0	
Total Samples > 20 ppb	0	0	0	0	0	

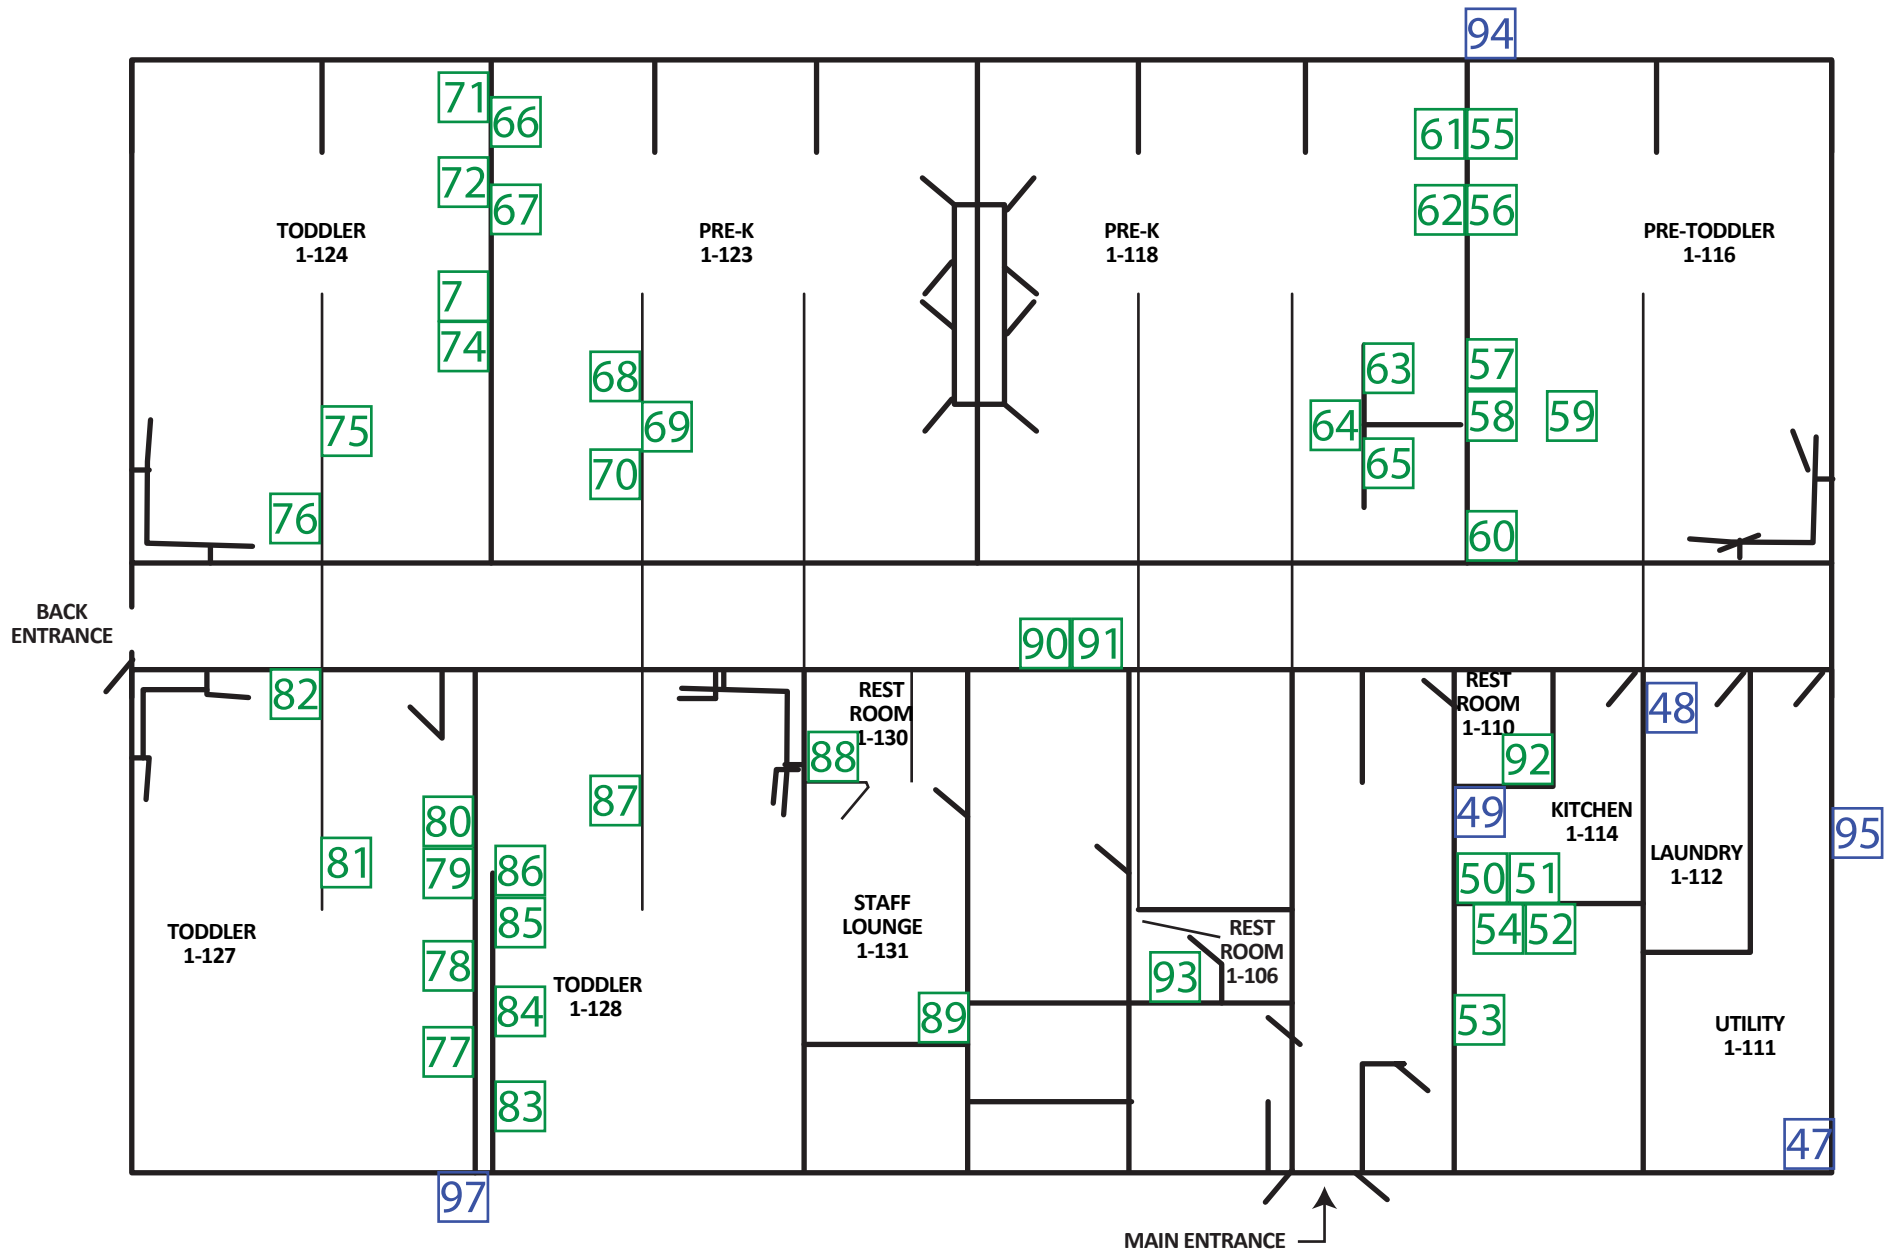

1 BUILDING 1641 - FLOOR PLAN



Outlet numbers pertaining to the floor plan.
 Red = Above 20 ppb
 Green = Below 20 ppb
 Blue = Not Sampled

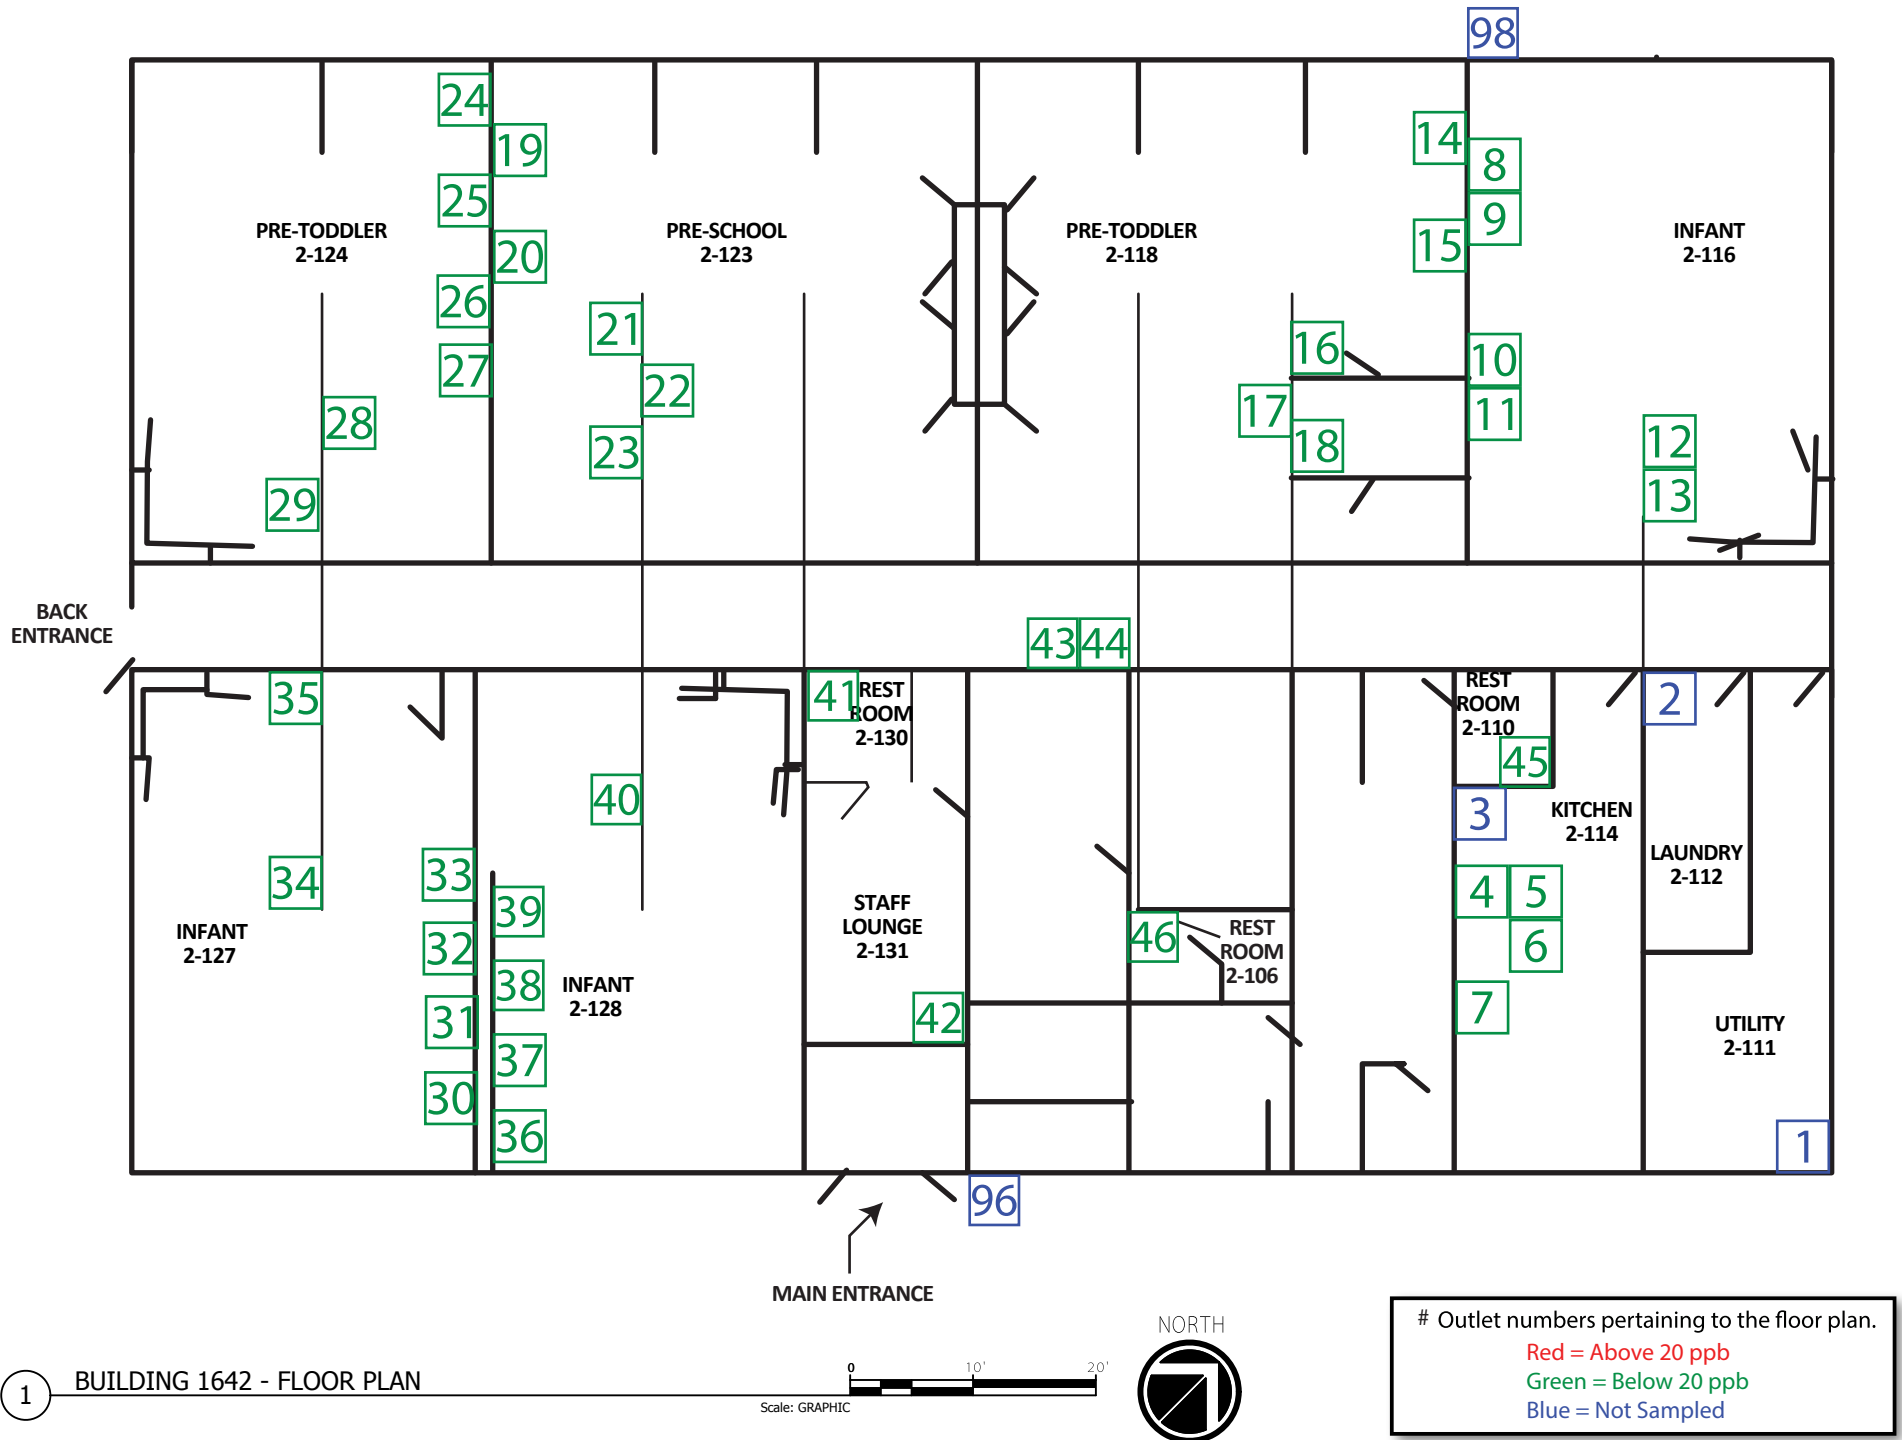

No.	Type of Fixture	Location Description	Sampled?	Exceeded?
1	Utility sink – not for drinking	Utility Room 2-111	No	N/A
2	Utility sink – not for drinking	Laundry Room 2-112	No	N/A
3	Dishwasher sprayer – not for drinking	Kitchen 2-114	No	N/A
4	Kitchen sink for dishwashing, food prep	Kitchen 2-114	Yes	No
5	Kitchen sink for dishwashing, food prep	Kitchen 2-114	Yes	No
6	High hand washing faucet	Kitchen 2-114	Yes	No
7	Kitchen sink for dishwashing, food prep	Kitchen 2-114	Yes	No
8	High hand washing faucet	Infant Room 2-116	Yes	No
9	Water fountain (bubbler)	Infant Room 2-116	Yes	No
10	Low hand washing faucet	Infant Room 2-116	Yes	No
11	Low hand washing faucet	Infant Room 2-116	Yes	No
12	High hand washing faucet	Infant Room 2-116	Yes	No
13	High hand washing faucet	Infant Room 2-116	Yes	No
14	Water fountain (bubbler)	Pre-toddler Room 2-118	Yes	No
15	High hand washing faucet	Pre-toddler Room 2-118	Yes	No
16	Low hand washing faucet	Pre-toddler Room 2-118	Yes	No
17	Low hand washing faucet used for teeth brushing	Pre-toddler Room 2-118	Yes	No
18	Low hand washing faucet	Pre-toddler Room 2-118	Yes	No
19	Water fountain (bubbler)	Preschool Room 2-123	Yes	No
20	High hand washing faucet	Preschool Room 2-123	Yes	No
21	Low hand washing faucet	Preschool Room 2-123	Yes	No
22	Low hand washing faucet used for teeth brushing	Preschool Room 2-123	Yes	No
23	Low hand washing faucet	Preschool Room 2-123	Yes	No
24	High hand washing faucet	Pre-toddler Room 2-124	Yes	No
25	Water fountain (bubbler)	Pre-toddler Room 2-124	Yes	No
26	Low hand washing faucet used for teeth brushing	Pre-toddler Room 2-124	Yes	No
27	Low hand washing faucet used for teeth brushing	Pre-toddler Room 2-124	Yes	No
28	High hand washing faucet	Pre-toddler Room 2-124	Yes	No
29	High hand washing faucet	Pre-toddler Room 2-124	Yes	No
30	High hand washing faucet	Infant Room 2-127	Yes	No
31	Water fountain (bubbler)	Infant Room 2-127	Yes	No
32	Low hand washing faucet	Infant Room 2-127	Yes	No
33	Low hand washing faucet	Infant Room 2-127	Yes	No
34	High hand washing faucet	Infant Room 2-127	Yes	No
35	High hand washing faucet	Infant Room 2-127	Yes	No
36	High hand washing faucet	Infant Room 2-128	Yes	No
37	Water fountain (bubbler)	Infant Room 2-128	Yes	No
38	Low hand washing faucet	Infant Room 2-128	Yes	No
39	Low hand washing faucet	Infant Room 2-128	Yes	No
40	High hand washing faucet	Infant Room 2-128	Yes	No
41	High hand washing faucet	Restroom 2-130	Yes	No
42	Kitchen sink for dishwashing, food prep	Staff Lounge 2-131	Yes	No
43	Water fountain (cooler)	Hallway	Yes	No
44	Water fountain (cooler)	Hallway	Yes	No
45	High hand washing faucet	Restroom 2-110	Yes	No
46	High hand washing faucet	Restroom 2-106	Yes	No
47	Utility sink – not for drinking	Utility Room 1-111	No	N/A
48	Utility sink – not for drinking	Laundry Room 1-112	No	N/A
49	Dishwasher sprayer – not for drinking	Kitchen 1-114	No	N/A
50	Kitchen sink for dishwashing, food prep	Kitchen 1-114	Yes	No

Outlet numbers pertaining to the floor plan.

Red = Above 20 ppb
Green = Below 20 ppb
Blue = Not Sampled

No.	Type of Fixture	Location Description	Sampled?	Exceeded?
51	Kitchen sink for dishwashing, food prep	Kitchen 1-114	Yes	No
52	High hand washing faucet	Kitchen 1-114	Yes	No
53	Kitchen sink for dishwashing, food prep	Kitchen 1-114	Yes	No
54	Icemaker	Kitchen 1-114	Yes	No
55	High hand washing faucet	Pre-toddler Room 1-116	Yes	No
56	Water fountain (bubbler)	Pre-toddler Room 1-116	Yes	No
57	Low hand washing faucet used for teeth brushing	Pre-toddler Room 1-116	Yes	No
58	Low hand washing faucet used for teeth brushing	Pre-toddler Room 1-116	Yes	No
59	High hand washing faucet	Pre-toddler Room 1-116	Yes	No
60	High hand washing faucet	Pre-toddler Room 1-116	Yes	No
61	Water fountain (bubbler)	Pre-K Room 1-118	Yes	No
62	High hand washing faucet	Pre-K Room 1-118	Yes	No
63	Low hand washing faucet	Pre-K Room 1-118	Yes	No
64	Low hand washing faucet used for teeth brushing	Pre-K Room 1-118	Yes	No
65	Low hand washing faucet	Pre-K Room 1-118	Yes	No
66	Water fountain (bubbler)	Pre-K Room 1-123	Yes	No
67	High hand washing faucet	Pre-K Room 1-123	Yes	No
68	Low hand washing faucet	Pre-K Room 1-123	Yes	No
69	Low hand washing faucet used for teeth brushing	Pre-K Room 1-123	Yes	No
70	Low hand washing faucet	Pre-K Room 1-123	Yes	No
71	High hand washing faucet	Toddler Room 1-124	Yes	No
72	Water fountain (bubbler)	Toddler Room 1-124	Yes	No
73	Low hand washing faucet used for teeth brushing	Toddler Room 1-124	Yes	No
74	Low hand washing faucet used for teeth brushing	Toddler Room 1-124	Yes	No
75	High hand washing faucet	Toddler Room 1-124	Yes	No
76	High hand washing faucet	Toddler Room 1-124	Yes	No
77	High hand washing faucet	Toddler Room 1-127	Yes	No
78	Water fountain (bubbler)	Toddler Room 1-127	Yes	No
79	Low hand washing faucet used for teeth brushing	Toddler Room 1-127	Yes	No
80	Low hand washing faucet used for teeth brushing	Toddler Room 1-127	Yes	No
81	High hand washing faucet	Toddler Room 1-127	Yes	No
82	High hand washing faucet	Toddler Room 1-127	Yes	No
83	High hand washing faucet	Toddler Room 1-128	Yes	No
84	Water fountain (bubbler)	Toddler Room 1-128	Yes	No
85	Low hand washing faucet used for teeth brushing	Toddler Room 1-128	Yes	No
86	Low hand washing faucet used for teeth brushing	Toddler Room 1-128	Yes	No
87	High hand washing faucet	Toddler Room 1-128	Yes	No
88	High hand washing faucet	Restroom 1-130	Yes	No
89	Kitchen sink for dishwashing, food prep	Staff Lounge 1-131	Yes	No
90	Water fountain (cooler)	Hallway	Yes	No
91	Water fountain (cooler)	Hallway	Yes	No
92	High hand washing faucet	Restroom 1-110	Yes	No
93	High hand washing faucet	Restroom 1-106	Yes	No
94	Hose outlet – not for drinking	Outside (northwest side of Building 1641)	No	N/A
95	Hose outlet – not for drinking	Outside (northeast side of Building 1641)	No	N/A
96	Hose outlet – not for drinking	Outside (southwest side of Building 1642)	No	N/A
97	Hose outlet – not for drinking	Outside (southwest side of Building 1641)	No	N/A
98	Hose outlet – not for drinking	Outside (northwest side of Building 1642)	No	N/A

Outlet numbers pertaining to the floor plan.

Red = Above 20 ppb
Green = Below 20 ppb
Blue = Not Sampled