

**Overview of Testing Results for Lead in Drinking Water
and Corrective Actions for
Joint Expeditionary Base Little Creek CDC (Building 3432)**

The Navy is committed to maintaining safe drinking water on its installations. City water supplied to the Navy and the Navy's water distribution system is regularly tested and in compliance with the Safe Drinking Water Act. Because lead exposure is a particular concern for children, and lead may be added to drinking water through the pipes, fittings, solder, and fixtures inside a building, the Environmental Protection Agency (EPA) recommends, but does not mandate, that we test the lead content of drinking water in priority areas such as youth centers (YCs), child development group homes (CDGHs), and child development centers (CDCs). The Navy has adopted the recommendation as policy.

Navy environmental personnel conducted lead testing at the JEB Little Creek CDC in accordance with Navy and EPA guidelines. Samples from various locations in the CDC were sent to a state-certified laboratory for analysis.

At the JEB Little Creek CDC, outlets used for drinking, cooking, and washing were tested. Out of **109** samples collected, no water outlets tested above the EPA-recommended screening level for lead in drinking water in schools and childcare centers of 20 parts per billion (ppb).

A copy of all test results is enclosed for your information. The test results are presented in two tables:

- Table 1 **Summary of Results** summarizes the data by category of use (e.g., drinking, cooking, washing).
- Table 2 **Summary Statistics** summarizes all the data.

A floor plan of the JEB Little Creek CDC has also been included to show the locations of the fixtures that were sampled.

Table 1 provides a description of each sampling location using three columns; *Category*, *Sampling ID*, and *Outlet Description*. The *Category* column gives information about whether the outlet is used for drinking water (water fountain), cooking (food preparation), or washing (primarily hand-washing or brushing teeth). The *Sample ID* column is the identification used to label each sample bottle. The *Outlet Description* column contains additional information to describe the outlet sampled under each category.

The next set of columns in **Table 1** provide *Initial Sampling Results*, and for those locations that exceeded the recommended screening level of 20 ppb the *Re-sampling Results*.

EPA sampling protocol requires water to not be used for between 8 and 18 hours prior to first draw sampling. Therefore, *Initial Sampling Results* were from first draw samples collected early in the morning before the CDC opened and before any water was used. The *Initial Sampling Results* also indicate whether resampling is required and the date that fixtures greater than 20 ppb were secured.

The *Re-sampling Results*, *Corrective Actions*, and *Post Remediation Sampling Results* columns are annotated N/A (not applicable) since all the samples at the JEB Little Creek CDC were within EPA recommended levels.

To learn more about lead in drinking water in schools and day care centers visit the following EPA website: <https://www.epa.gov/dwreginfo/lead-drinking-water-schools-and-child-care-facilities>.

To learn more about your home's public water supplier, see their annual water quality report: https://www.cnic.navy.mil/regions/cnrma/om/environmental_support/water_quality_information.html

To answer any questions you may have on the sampling program contact the JEB Little Creek-Fort Story Public Affairs Officer at 757-462-8425. If you have any health questions or concerns, you are encouraged to contact your health care provider or, if you are a TRICARE beneficiary, use the Mid-Atlantic Appointment Center to schedule an appointment with your primary care provider at 1-866-645-4584.

Enclosures:

1. Complete Test Results
2. Floor Plan of the JEB Little Creek CDC

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (September 2017)
JEB Little Creek Child Development Center, Building 3432

Table 1. Summary of Results

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE	POST REMEDIATION SAMPLING	
CATEGORY	SAMPLE ID NO.	SAMPLE ID	Outlet Description	Comments	First Draw (ppb)	Retest required?	Date Fixture Secured?	Lead Screening Level of 20ppb			Description	Recommended Level = 20ppb	
								Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)		First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					9/22/2017			N/A	N/A	N/A		N/A	
					10/2/2017			N/A	N/A	N/A		N/A	
DRINKING	5	JEBLC-3432-LOUNGE145-FRIDGE-FD	Water dispenser from refrigerator in Staff Lounge 145		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	6	JEBLC-3432-HALL-WFBA-FD	Water fountain bubbler (low) in Hallway		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	7	JEBLC-3432-HALL-WFBB-FD	Water fountain bubbler (high) in Hallway		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	30	JEBLC-3432-RM128-WFCOMB-FD	Water fountain outlet from combination sink in Toddler Room 128		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	36	JEBLC-3432-RM127-WFCOMB-FD	Water fountain outlet from combination sink in Toddler Room 127		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	42	JEBLC-3432-RM126-WFCOMB-FD	Water fountain outlet from combination sink in Toddler Room 126		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	48	JEBLC-3432-RM125-WFCOMB-FD	Water fountain outlet from combination sink in Toddler Room 125		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	54	JEBLC-3432-RM124-WFCOMB-FD	Water fountain outlet from combination sink in Toddler Room 124		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	60	JEBLC-3432-RM123-WFCOMB-FD	Water fountain outlet from combination sink in Toddler Room 123		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	73	JEBLC-3432-RM117-WFCOMB-FD	Water fountain outlet from combination sink in Preschool Room 117		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	79	JEBLC-3432-RM116-WFCOMB-FD	Water fountain outlet from combination sink in Preschool Room 116		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	85	JEBLC-3432-RM115-WFCOMB-FD	Water fountain outlet from combination sink in Preschool Room 115		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	4	JEBLC-3432-LOUNGE145-K-FD	Kitchen faucet used for food preparation and dishwashing in the Staff Lounge 145		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	65	JEBLC-3432-K120-KA-FD	Kitchen sink used for food preparation, dishwashing, and to fill water jugs in the Kitchen Room 120		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (September 2017)
JEB Little Creek Child Development Center, Building 3432

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS		RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING		
					Lead Screening Level of 20ppb						Recommended Level = 20ppb		
CATEGORY	SAMPLE ID NO.	SAMPLE ID	Outlet Description	Comments	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					9/22/2017			N/A	N/A	N/A		N/A	
					10/2/2017			N/A	N/A	N/A		N/A	
COOKING	67	JEBLC-3432-K120-KB-FD	Kitchen sink used for food preparation and dishwashing in the Kitchen Room 120		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	68	JEBLC-3432-K120-KC-FD	Kitchen sink used for food preparation in the Kitchen Room 120		2	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COOKING	69	JEBLC-3432-K120-KD-FD	Kitchen sink used for food preparation, dishwashing, and to fill water jugs in the Kitchen Room 120		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	29	JEBLC-3432-RM128-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Toddler Room 128		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	35	JEBLC-3432-RM127-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Toddler Room 127		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	41	JEBLC-3432-RM126-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Toddler Room 126		1	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	47	JEBLC-3432-RM125-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Toddler Room 125		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	53	JEBLC-3432-RM124-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Toddler Room 124		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	59	JEBLC-3432-RM123-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Toddler Room 123		2	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	72	JEBLC-3432-RM117-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Preschool Room 117		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	78	JEBLC-3432-RM116-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Preschool Room 116		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	84	JEBLC-3432-RM115-HWCOMB-FD	Low handwashing faucet from combination sink (used for teeth brushing) in Preschool Room 115		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (September 2017)
JEB Little Creek Child Development Center, Building 3432

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS		RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING		
					Lead Screening Level of 20ppb						Recommended Level = 20ppb		
CATEGORY	SAMPLE ID NO.	SAMPLE ID	Outlet Description	Comments	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					9/22/2017			N/A	N/A	N/A		N/A	
					10/2/2017			N/A	N/A	N/A		N/A	
WASHING	1	JEBLC-3432-BATH148-HHW-FD	High handwashing faucet with motion sensor in Restroom 148		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	2	JEBLC-3432-BATH147-HHW-FD	High handwashing faucet with motion sensor in Restroom 147		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	3	JEBLC-3432-BATH146-HHW-FD	High handwashing faucet with motion sensor in Restroom 146		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	8	JEBLC-3432-RM143-HHW-FD	High handwashing faucet in Infant Room 143		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	9	JEBLC-3432-BATH143-HHW-FD	High handwashing faucet with motion sensor in Infant Room 143		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	10	JEBLC-3432-RM142-HHWA-FD	High handwashing faucet in Infant Room 142		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	11	JEBLC-3432-BATH142-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 142		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	12	JEBLC-3432-RM141-HHWA-FD	High handwashing faucet in Infant Room 141		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	13	JEBLC-3432-BATH141-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 141		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	14	JEBLC-3432-RM140-HHWA-FD	High handwashing faucet in Infant Room 140		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	15	JEBLC-3432-BATH140-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 140		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	16	JEBLC-3432-RM139-HHWA-FD	High handwashing faucet in Infant Room 139		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	17	JEBLC-3432-BATH139-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 139		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	18	JEBLC-3432-RM138-HHWA-FD	High handwashing faucet in Infant Room 138		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	19	JEBLC-3432-BATH138-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 138		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	20	JEBLC-3432-RM137-HHWA-FD	High handwashing faucet in Infant Room 137		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	21	JEBLC-3432-BATH137-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 137		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	22	JEBLC-3432-RM136-HHWA-FD	High handwashing faucetin Infant Room 136		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	23	JEBLC-3432-BATH136-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 136		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	24	JEBLC-3432-RM135-HHWA-FD	High handwashing faucet in Infant Room 135		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	25	JEBLC-3432-BATH135-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 135		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	26	JEBLC-3432-RM134-HHWA-FD	High handwashing faucet in Infant Room 134		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (September 2017)
JEB Little Creek Child Development Center, Building 3432

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS		RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING		
					Lead Screening Level of 20ppb						Recommended Level = 20ppb		
CATEGORY	SAMPLE ID NO.	SAMPLE ID	Outlet Description	Comments	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					9/22/2017			N/A	N/A	N/A		N/A	
					10/2/2017			N/A	N/A	N/A		N/A	
WASHING	27	JEBLC-3432-BATH134-HHWB-FD	High handwashing faucet with motion sensor in restroom within Infant Room 134		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	28	JEBLC-3432-RM128-HHW-FD	High handwashing faucet in Toddler Room 128		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	31	JEBLC-3432-BATH128-HHW-FD	High handwashing faucet with motion sensor in restroom within Toddler Room 128		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	32	JEBLC-3432-BATH128-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 128		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	33	JEBLC-3432-BATH128-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 128		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	34	JEBLC-3432-RM127-HHW-FD	High handwashing faucet in Toddler Room 127		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	37	JEBLC-3432-BATH127-HHW-FD	High handwashing faucet with motion sensor in restroom within Toddler Room 127		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	38	JEBLC-3432-BATH127-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 127		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	39	JEBLC-3432-BATH127-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 127		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	40	JEBLC-3432-RM126-HHW-FD	High handwashing faucet in Toddler Room 126		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	43	JEBLC-3432-BATH126-HHW-FD	High handwashing faucet with motion sensor in restroom within Toddler Room 126		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	44	JEBLC-3432-BATH126-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 126		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	45	JEBLC-3432-BATH126-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 126		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	46	JEBLC-3432-RM125-HHW-FD	High handwashing faucet in Toddler Room 125		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	49	JEBLC-3432-BATH125-HHW-FD	High handwashing faucet with motion sensor in restroom within Toddler Room 125		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	50	JEBLC-3432-BATH125-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 125		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	51	JEBLC-3432-BATH125-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 125		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (September 2017)
JEB Little Creek Child Development Center, Building 3432

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS		RE-SAMPLING RESULTS				CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING	
					Lead Screening Level of 20ppb							Recommended Level = 20ppb	
CATEGORY	SAMPLE ID NO.	SAMPLE ID	Outlet Description	Comments	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					9/22/2017			N/A	N/A	N/A		N/A	
					10/2/2017			N/A	N/A	N/A		N/A	
WASHING	52	JEBLC-3432-RM124-HHW-FD	High handwashing faucet in Toddler Room 124		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	55	JEBLC-3432-BATH124-HHW-FD	High handwashing faucet with motion sensor in restroom within Toddler Room 124		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	56	JEBLC-3432-BATH124-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 124		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	57	JEBLC-3432-BATH124-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 124		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	58	JEBLC-3432-RM123-HHW-FD	High handwashing faucet in Toddler Room 123		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	61	JEBLC-3432-BATH123-HHW-FD	High handwashing faucet with motion sensor in restroom within Toddler Room 123		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	62	JEBLC-3432-BATH123-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 123		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	63	JEBLC-3432-BATH123-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Toddler Room 123		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	64	JEBLC-3432-K120-HHWA-FD	High handwashing faucet in the Kitchen Room 120		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	66	JEBLC-3432-K120-HHWB-FD	High handwashing faucet in the Kitchen Room 120		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	70	JEBLC-3432-BATH119-HHW-FD	High handwashing faucet with motion sensor in Restroom 119		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	71	JEBLC-3432-RM117-HHW-FD	High handwashing faucet in Preschool Room 117		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	74	JEBLC-3432-BATH117-HHW-FD	High handwashing faucet with motion sensor in restroom within Preschool Room 117		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	75	JEBLC-3432-BATH117-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Preschool Room 117		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	76	JEBLC-3432-BATH117-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Preschool Room 117		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	77	JEBLC-3432-RM116-HHW-FD	High handwashing faucet in Preschool Room 116		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	80	JEBLC-3432-BATH116-HHW-FD	High handwashing faucet with motion sensor in restroom within Preschool Room 116		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A


Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (September 2017)
JEB Little Creek Child Development Center, Building 3432

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST REMEDIATION SAMPLING	
					Lead Screening Level of 20ppb							Recommended Level = 20ppb	
CATEGORY	SAMPLE ID NO.	SAMPLE ID	Outlet Description	Comments	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					9/22/2017			N/A	N/A	N/A		N/A	
					10/2/2017			N/A	N/A	N/A		N/A	
WASHING	81	JEBLC-3432-BATH116-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Preschool Room 116		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	82	JEBLC-3432-BATH116-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Preschool Room 116		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	83	JEBLC-3432-RM115-HHW-FD	High handwashing faucet in Preschool Room 115		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	86	JEBLC-3432-BATH115-HHW-FD	High handwashing faucet with motion sensor in restroom within Preschool Room 115		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	87	JEBLC-3432-BATH115-LHWA-FD	Low handwashing faucet with motion sensor in restroom within Preschool Room 115		2	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	88	JEBLC-3432-BATH115-LHWB-FD	Low handwashing faucet with motion sensor in restroom within Preschool Room 115		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	89	JEBLC-3432-RM110-HHW-FD	High handwashing faucet in Pre-Toddler Room 110		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	90	JEBLC-3432-BATH110-HHW-FD	High handwashing faucet with motion sensor in restroom within Pre-Toddler Room 110		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	91	JEBLC-3432-BATH110-LHW-FD	Low handwashing faucet with motion sensor in restroom within Pre-Toddler Room 110		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	92	JEBLC-3432-RM109-HHW-FD	High handwashing faucet in Pre-Toddler Room 109		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	93	JEBLC-3432-BATH109-HHW-FD	High handwashing faucet with motion sensor in restroom within Pre-Toddler Room 109		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	94	JEBLC-3432-BATH109-LHW-FD	Low handwashing faucet with motion sensor in restroom within Pre-Toddler Room 109		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	95	JEBLC-3432-RM108-HHW-FD	High handwashing faucet in Pre-Toddler Room 108		6	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	96	JEBLC-3432-BATH108-HHW-FD	High handwashing faucet with motion sensor in restroom within Pre-Toddler Room 108		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	97	JEBLC-3432-BATH108-LHW-FD	Low handwashing faucet with motion sensor in restroom within Pre-Toddler Room 108		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	98	JEBLC-3432-RM107-HHW-FD	High handwashing faucet in Pre-Toddler Room 107		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	99	JEBLC-3432-BATH107-HHW-FD	High handwashing faucet with motion sensor in restroom within Pre-Toddler Room 107		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	100	JEBLC-3432-BATH107-LHW-FD	Low handwashing faucet with motion sensor in restroom within Pre-Toddler Room 107		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE	POST REMEDIATION SAMPLING	
					Lead Screening Level of 20ppb						ACTIONS	Recommended Level = 20ppb	
CATEGORY	SAMPLE ID NO.	SAMPLE ID	Outlet Description	Comments	First Draw (ppb)	Retest required?	Date Fixture Secured?	Water Fountain 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					9/22/2017			N/A	N/A	N/A		N/A	
					10/2/2017			N/A	N/A	N/A		N/A	
WASHING	101	JEBLC-3432-RM106-HHW-FD	High handwashing faucet in Pre-Toddler Room 106		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	102	JEBLC-3432-BATH106-HHW-FD	High handwashing faucet with motion sensor in restroom within Pre-Toddler Room 106		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	103	JEBLC-3432-BATH106-LHW-FD	Low handwashing faucet with motion sensor in restroom within Pre-Toddler Room 106		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	104	JEBLC-3432-RM105-HHW-FD	High handwashing faucet in Pre-Toddler Room 105		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	105	JEBLC-3432-BATH105-HHW-FD	High handwashing faucet with motion sensor in restroom within Pre-Toddler Room 105		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	106	JEBLC-3432-BATH105-LHW-FD	Low handwashing faucet with motion sensor in restroom within Pre-Toddler Room 105		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	107	JEBLC-3432-RM104-HHW-FD	High handwashing faucet in Pre-Toddler Room 104		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	108	JEBLC-3432-BATH104-HHW-FD	High handwashing faucet with motion sensor in restroom within Pre-Toddler Room 104		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A
WASHING	109	JEBLC-3432-BATH104-LHW-FD	Low handwashing faucet with motion sensor in restroom within Pre-Toddler Room 104		non-detect	No	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Table 2. Summary Statistics

CATEGORY	INITIAL SAMPLING RESULTS		RE-SAMPLING RESULTS			POST
	Lead Screening Level of 20ppb					
	First Draw (ppb)		Water Fountain Follow up Flush Sample - Collected day before First Draw Sampling (ppb)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	First Draw (ppb)
Total Drinking	12		N/A	N/A	N/A	N/A
Total Drinking > 20 ppb	0		N/A	N/A	N/A	N/A
Total Cooking	5		N/A	N/A	N/A	N/A
Total Cooking> 20 ppb	0		N/A	N/A	N/A	N/A
Total Washing	92		N/A	N/A	N/A	N/A
Total Washing > 20 ppb	0		N/A	N/A	N/A	N/A
Total Samples	109		N/A	N/A	N/A	N/A
Total Samples > 20 ppb	0		N/A	N/A	N/A	N/A

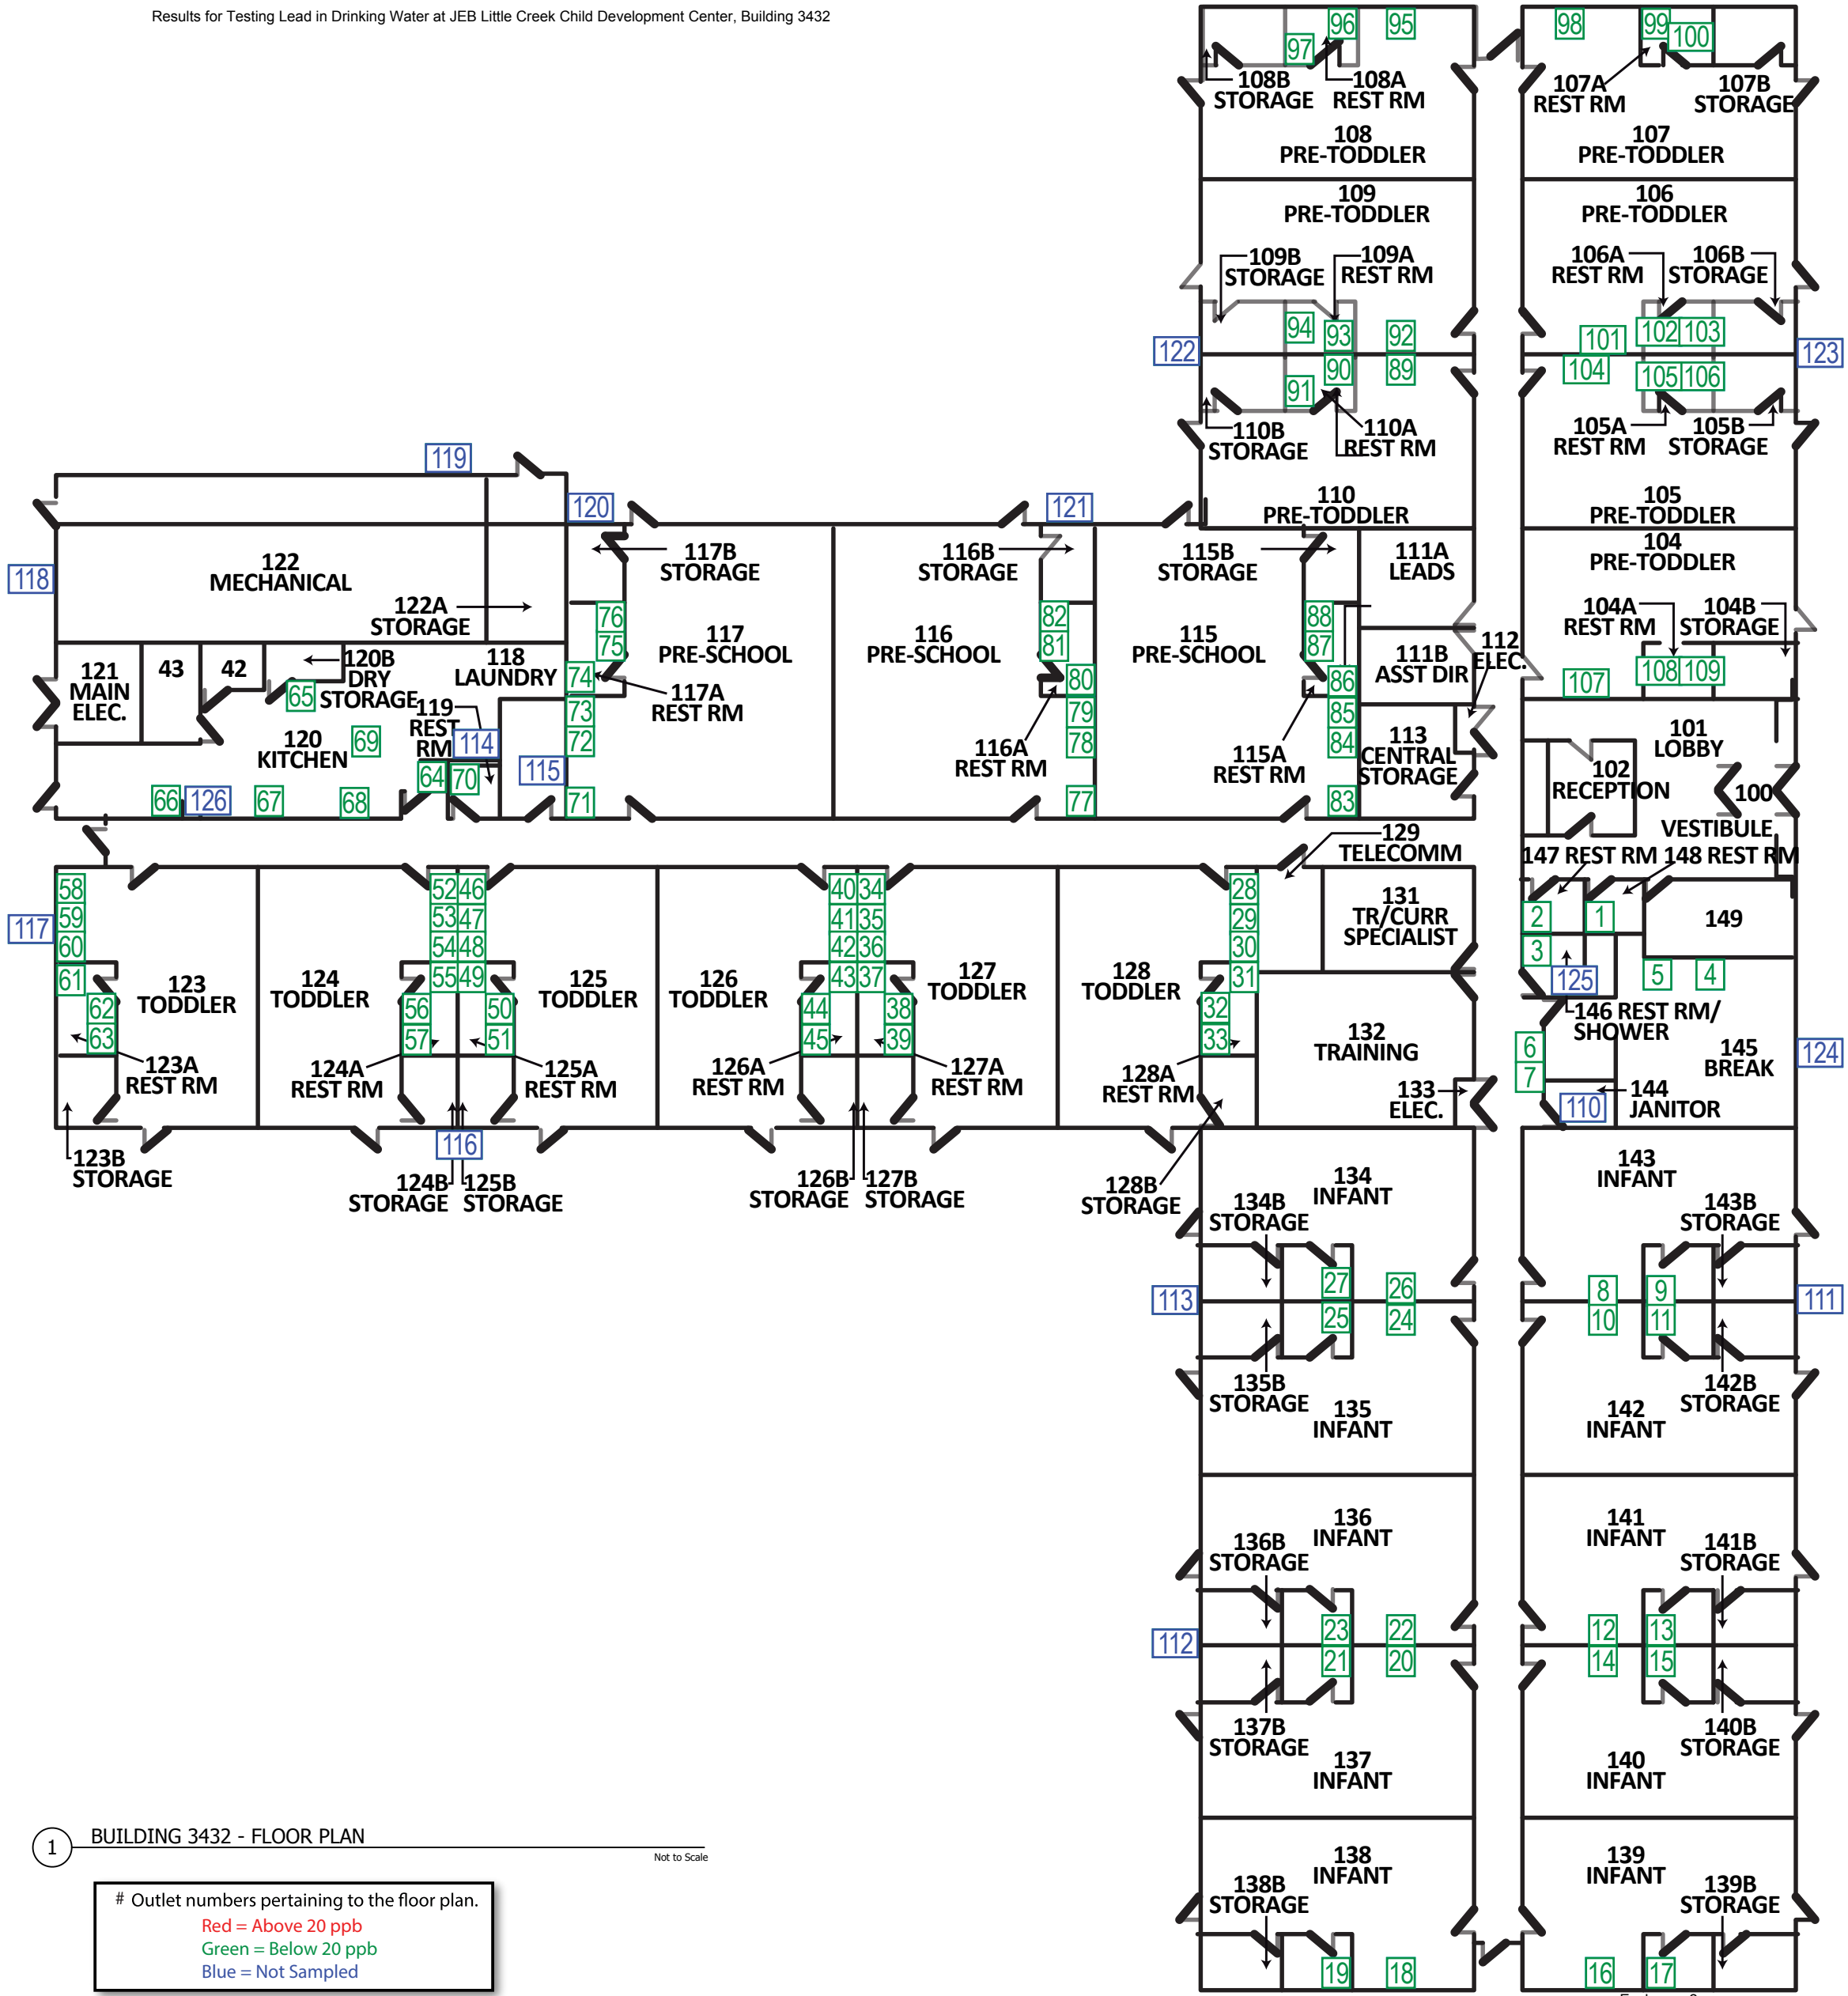

No.	Type of Fixture	Location Description	Exceeded?
1	High handwashing faucet with motion sensor	Restroom 148	No
2	High handwashing faucet with motion sensor	Restroom 147	No
3	High handwashing faucet with motion sensor	Restroom 146	No
4	Kitchen sink used for food preparation and dishwashing	Staff Lounge 145	No
5	Water dispenser from refrigerator	Staff Lounge 145	No
6	Water fountain bubbler (low)	Hallway	No
7	Water fountain bubbler (high)	Hallway	No
8	High hand washing faucet	Infant Room 143	No
9	High handwashing faucet with motion sensor	Restroom within Infant Room 143	No
10	High hand washing faucet	Infant Room 142	No
11	High handwashing faucet with motion sensor	Restroom within Infant Room 142	No
12	High hand washing faucet	Infant Room 141	No
13	High handwashing faucet with motion sensor	Restroom within Infant Room 141	No
14	High hand washing faucet	Infant Room 140	No
15	High handwashing faucet with motion sensor	Restroom within Infant Room 140	No
16	High hand washing faucet	Infant Room 139	No
17	High handwashing faucet with motion sensor	Restroom within Infant Room 139	No
18	High hand washing faucet	Infant Room 138	No
19	High handwashing faucet with motion sensor	Restroom within Infant Room 138	No
20	High hand washing faucet	Infant Room 137	No
21	High handwashing faucet with motion sensor	Restroom within Infant Room 137	No
22	High hand washing faucet	Infant Room 136	No
23	High handwashing faucet with motion sensor	Restroom within Infant Room 136	No
24	High hand washing faucet	Infant Room 135	No
25	High handwashing faucet with motion sensor	Restroom within Infant Room 135	No
26	High hand washing faucet	Infant Room 134	No
27	High handwashing faucet with motion sensor	Restroom within Infant Room 134	No
28	High hand washing faucet	Toddler Room 128	No
29	Low hand washing faucet from combination sink (used for teeth brushing)	Toddler Room 128	No
30	Water fountain outlet from combination sink	Toddler Room 128	No
31	High handwashing faucet with motion sensor	Restroom within Toddler Room 128	No
32	Low hand washing faucet with motion sensor	Restroom within Toddler Room 128	No
33	Low hand washing faucet with motion sensor	Restroom within Toddler Room 128	No
34	High hand washing faucet	Toddler Room 127	No
35	Low hand washing faucet from combination sink (used for teeth brushing)	Toddler Room 127	No
36	Water fountain outlet from combination sink	Toddler Room 127	No
37	High handwashing faucet with motion sensor	Restroom within Toddler Room 127	No
38	Low hand washing faucet with motion sensor	Restroom within Toddler Room 127	No
39	Low hand washing faucet with motion sensor	Restroom within Toddler Room 127	No
40	High hand washing faucet	Toddler Room 126	No
41	Low hand washing faucet from combination sink (used for teeth brushing)	Toddler Room 126	No
42	Water fountain outlet from combination sink	Toddler Room 126	No
43	High handwashing faucet with motion sensor	Restroom within Toddler Room 126	No
44	Low hand washing faucet with motion sensor	Restroom within Toddler Room 126	No
45	Low hand washing faucet with motion sensor	Restroom within Toddler Room 126	No
46	High hand washing faucet	Toddler Room 125	No

No.	Type of Fixture	Location Description	Exceeded?
47	Low hand washing faucet from combination sink (used for teeth brushing)	Toddler Room 125	No
48	Water fountain outlet from combination sink	Toddler Room 125	No
49	High handwashing faucet with motion sensor	Restroom within Toddler Room 125	No
50	Low hand washing faucet with motion sensor	Restroom within Toddler Room 125	No
51	Low hand washing faucet with motion sensor	Restroom within Toddler Room 125	No
52	High hand washing faucet	Toddler Room 124	No
53	Low hand washing faucet from combination sink (used for teeth brushing)	Toddler Room 124	No
54	Water fountain outlet from combination sink	Toddler Room 124	No
55	High handwashing faucet with motion sensor	Restroom within Toddler Room 124	No
56	Low hand washing faucet with motion sensor	Restroom within Toddler Room 124	No
57	Low hand washing faucet with motion sensor	Restroom within Toddler Room 124	No
58	High hand washing faucet	Toddler Room 123	No
59	Low hand washing faucet from combination sink (used for teeth brushing)	Toddler Room 123	No
60	Water fountain outlet from combination sink	Toddler Room 123	No
61	High handwashing faucet with motion sensor	Restroom within Toddler Room 123	No
62	Low hand washing faucet with motion sensor	Restroom within Toddler Room 123	No
63	Low hand washing faucet with motion sensor	Restroom within Toddler Room 123	No
64	High hand washing faucet	Kitchen Room 120	No
65	Kitchen sink used for food preparation, dishwashing, and to fill water jugs	Kitchen Room 120	No
66	High hand washing faucet	Kitchen Room 120	No
67	Kitchen sink used for food preparation and dishwashing	Kitchen Room 120	No
68	Kitchen faucet used for food preparation	Kitchen Room 120	No
69	Kitchen sink used for food preparation, dishwashing, and to fill water jugs	Kitchen Room 120	No
70	High handwashing faucet with motion sensor	Restroom 119	No
71	High hand washing faucet	Preschool Room 117	No
72	Low hand washing faucet from combination sink (used for teeth brushing)	Preschool Room 117	No
73	Water fountain outlet from combination sink	Preschool Room 117	No
74	High handwashing faucet with motion sensor	Restroom within Preschool Room 117	No
75	Low hand washing faucet with motion sensor	Restroom within Preschool Room 117	No
76	Low hand washing faucet with motion sensor	Restroom within Preschool Room 117	No
77	High hand washing faucet	Preschool Room 116	No
78	Low hand washing faucet from combination sink (used for teeth brushing)	Preschool Room 116	No
79	Water fountain outlet from combination sink	Preschool Room 116	No
80	High handwashing faucet with motion sensor	Restroom within Preschool Room 116	No
81	Low hand washing faucet with motion sensor	Restroom within Preschool Room 116	No
82	Low hand washing faucet with motion sensor	Restroom within Preschool Room 116	No
83	High hand washing faucet	Preschool Room 115	No
84	Low hand washing faucet from combination sink (used for teeth brushing)	Preschool Room 115	No
85	Water fountain outlet from combination sink	Preschool Room 115	No
86	High handwashing faucet with motion sensor	Restroom within Preschool Room 115	No
87	Low hand washing faucet with motion sensor	Restroom within Preschool Room 115	No

No.	Type of Fixture	Location Description	Exceeded?
88	Low hand washing faucet with motion sensor	Restroom within Preschool Room 115	No
89	High hand washing faucet	Pre-Toddler Room 110	No
90	High handwashing faucet with motion sensor	Restroom within Pre-Toddler Room 110	No
91	Low hand washing faucet with motion sensor	Restroom within Pre-Toddler Room 110	No
92	High hand washing faucet	Pre-Toddler Room 109	No
93	High handwashing faucet with motion sensor	Restroom within Pre-Toddler Room 109	No
94	Low hand washing faucet with motion sensor	Restroom within Pre-Toddler Room 109	No
95	High hand washing faucet	Pre-Toddler Room 108	No
96	High handwashing faucet with motion sensor	Restroom within Pre-Toddler Room 108	No
97	Low hand washing faucet with motion sensor	Restroom within Pre-Toddler Room 108	No
98	High hand washing faucet	Pre-Toddler Room 107	No
99	High handwashing faucet with motion sensor	Restroom within Pre-Toddler Room 107	No
100	Low hand washing faucet with motion sensor	Restroom within Pre-Toddler Room 107	No
101	High hand washing faucet	Pre-Toddler Room 106	No
102	High handwashing faucet with motion sensor	Restroom within Pre-Toddler Room 106	No
103	Low hand washing faucet with motion sensor	Restroom within Pre-Toddler Room 106	No
104	High hand washing faucet	Pre-Toddler Room 105	No
105	High handwashing faucet with motion sensor	Restroom within Pre-Toddler Room 105	No
106	Low hand washing faucet with motion sensor	Restroom within Pre-Toddler Room 105	No
107	High hand washing faucet	Pre-Toddler Room 104	No
108	High handwashing faucet with motion sensor	Restroom within Pre-Toddler Room 104	No
109	Low hand washing faucet with motion sensor	Restroom within Pre-Toddler Room 104	No
110	Utility Sink	Utility Room 144	Not Sampled
111	Hose bib	Outside on east side of Building 3432	Not Sampled
112	Hose bib	Outside on west side of Building 3432	Not Sampled
113	Hose bib	Outside on west side of Building 3432	Not Sampled
114	Dishwashing sprayer	Kitchen Room 120	Not Sampled
115	Utility Sink	Laundry Room 118	Not Sampled
116	Hose bib	Outside on south side of Building 3432	Not Sampled
117	Hose bib	Outside on west side of Building 3432	Not Sampled
118	Hose bib	Outside on west side of Building 3432	Not Sampled
119	Hose bib	Outside on north side of Building 3432	Not Sampled
120	Hose bib	Outside on north side of Building 3432	Not Sampled
121	Hose bib	Outside on north side of Building 3432	Not Sampled
122	Hose bib	Outside on west side of Building 3432	Not Sampled
123	Hose bib	Outside on east side of Building 3432	Not Sampled
124	Hose bib	Outside on east side of Building 3432	Not Sampled
125	Shower	Restroom 146	Not Sampled
126	Utility Sink	Kitchen Room 120	Not Sampled

Outlet numbers pertaining to the floor plan.

Red = Above 20 ppb

Green = Below 20 ppb

Blue = Not Sampled